



GENERATOR ON
PLINTH

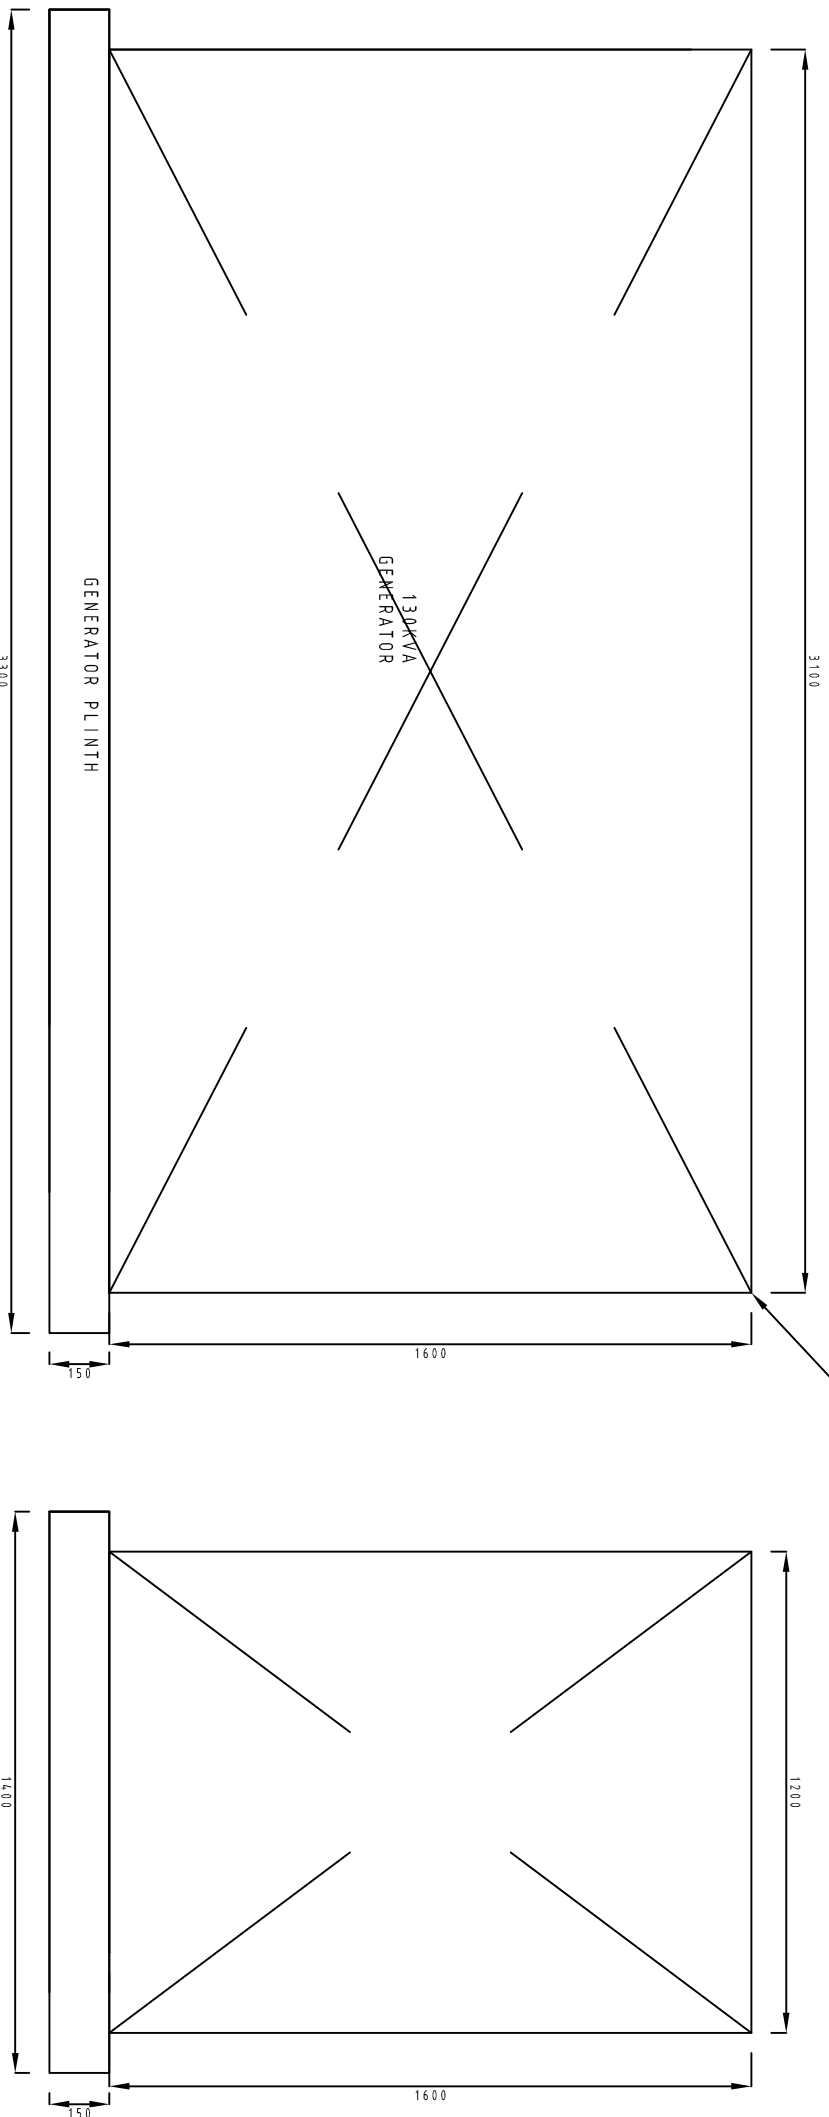

GENERATOR PLINTH

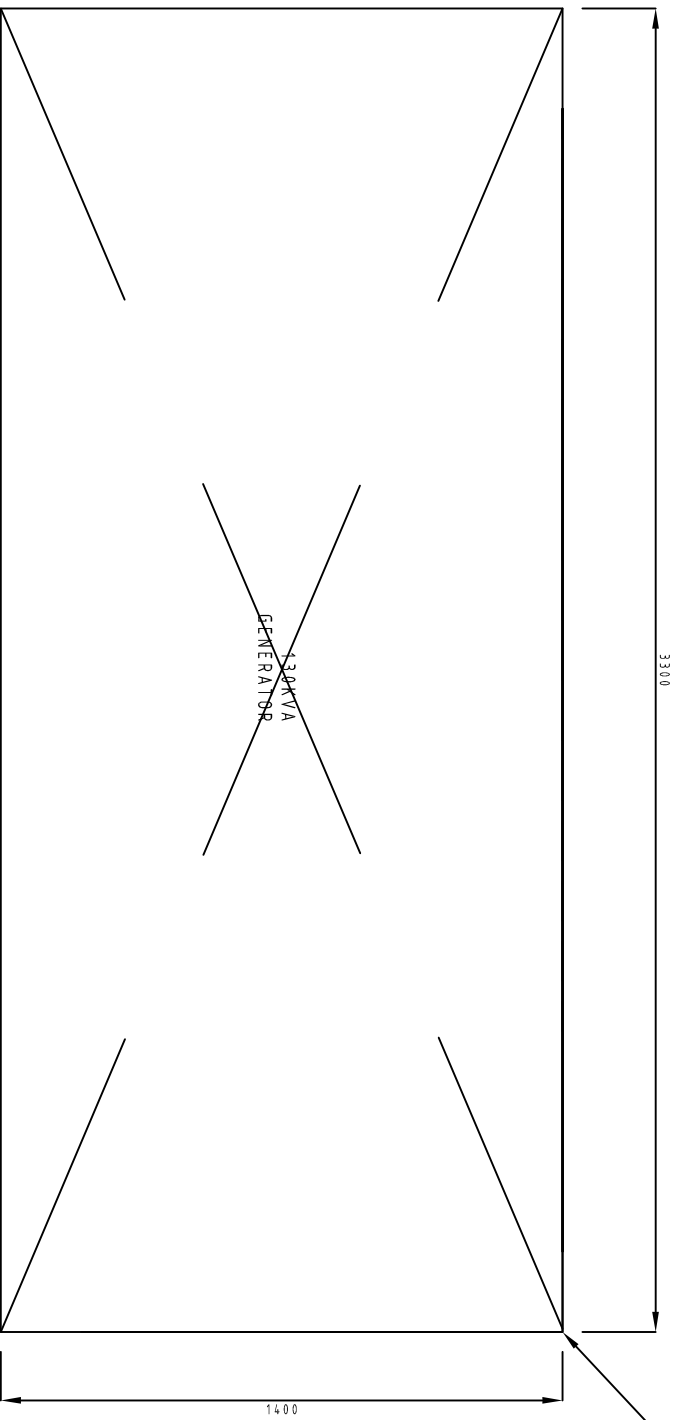

Note
 The concrete plinth needs to be a minimum 30MPA concrete either vibrated or with 193 mesh, 50mm from the top.
 The generator should be situated 800mm away from walls at all sides for ventilation & service purposes.

ELECTRICAL NOTES:

Rev	Description	Date
1	GENERATOR PLINTH	

PROJECT TITLE:

DRAWING Title:

130KVA GENERATOR
PLINTH DETAIL

DRAWING No.

E 100

REVISION:

1

DATE:

SCALE:

DESIGNED:

DRAWN:

CHECKED:

GEN-TEK

POWERED GENERATOR SOLUTIONS

Gen Motion Ltd Trading as GEN TEK
101 Derby Rd Judiths Paarl JHB 2000
Tel +27 11 627 7550 Fax +2711 614 5641
Website www.gen-tek.co.za E-mail sales@gen-tek.co.za

THIS IS AN AUTOCAD GENERATED DRAWING